


GLAZED FLAT PLATE SOLAR COLLECTORS Models EC and EP SPECIFICATION SHEET

THE VALUE LEADER IN SOLAR WATER HEATING TECHNOLOGY

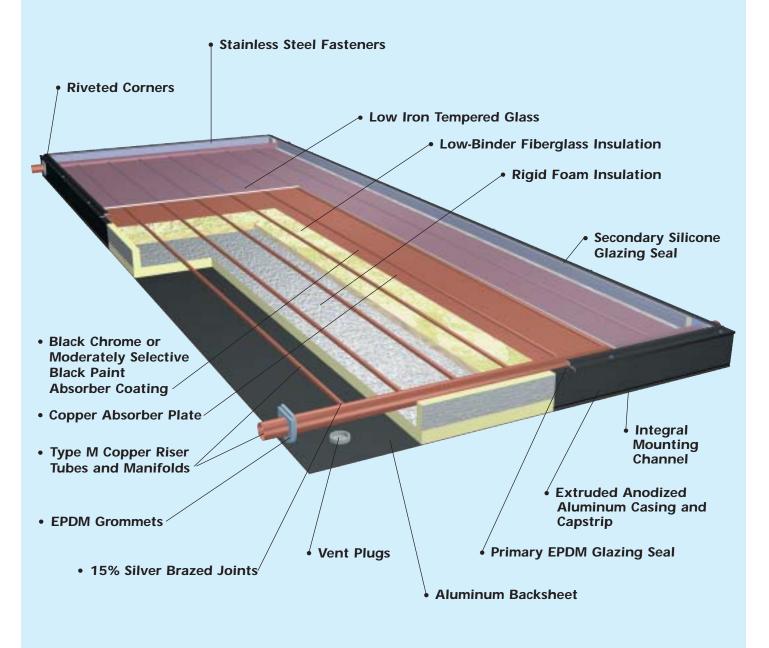

PROTECTING OUR ENVIRONMENT—SINCE 1978

EMPIRE SERIES SPECIFICATIONS

SunEarth Model No.	Width Inches	Length Inches	Depth	Gross Area So Et	Net Aberture		Fluid Capacity	Design Flow	Pressure Drop at Design Floor	8/5	<u>i</u> (<u>i</u> 2		teac in	Vominal Header, Center to Center, Inc.
EC/EP21	40	76	3 1/4	21.12	18.70	70	0.72	0.54	0.003	12	160	43 3/8	1	71.25
EC/EP24	36 1/8	98 1/4	3 1/4	24.61	21.88	80	0.78	0.62	0.005	12	160	39 3/4	1	93 5/8
EC/EP32	48 1/8	98 1/4	3 1/4	32.79	29.81	106	1.00	0.83	0.006	12	160	51 3/8	1	93 5/8
EC/EP40	48 1/8	122 1/4	3 1/4	40.81	37.33	141	1.20	1.04	0.009	12	160	51 3/8	1	115 5/8
EC/EP40-1.5	48 1/8	122 1/4	3 1/4	40.81	37.33	150	1.61	1.04	0.006	25	160	51 3/8	1 1/2	115 5/8

MODEL EC

THERMAL PERFORMANCE RATINGS*

MODEL EP

Btu/ft ² /Day					Btu/ft ² /Day				
Category (Ti-Ta) Ti = inlet fluid temp Ta = ambient air temp	CLEAR DAY 2000 Btu/ft ² /Day	MILDLY CLOUDY DAY 1500 Btu/ft ² /Day	CLOUDY DAY 1000 Btu/ft ² /Day		Category (Ti-Ta) Ti = inlet fluid temp Ta = ambient air temp	CLEAR DAY 2000 Btu/ft ² /Day	MILDLY CLOUDY DAY 1500 Btu/ft ² /Day	CLOUDY DAY 1000 Btu/ft ² /Day	
A(-9°F)	1,332	1,005	680		A(-9°F)	1,284	971	659	
B(9°F)	1,218	890	565		B(9°F)	1,169	854	542	
C(36°F)	1,040	720	402		C(36°F)	984	677	372	
D(90°F)	699	405	127]	D(90°F)	619	343	89	
E(144°F)	390	137	-		E(144°F)	280	62	-	

A-Pool Heating (Warm Climate) B-Pool Heating C-Water Heating (Warm Climate) D-Water Heating (Cool Climate) E-Air Conditioning/Industrial Process Heat. Thermal performance is obtained by multiplying the collector output for the appropriate application and insolation level by the total gross collector area. *Collector ratings are derived from the Solar Rating & Certification Corp (SRCC) Document RM-1 and Standard OG-100.

ENGINEERING SPECIFICATIONS

The following shall be the specifications for the solar collectors. Collectors shall be SunEarth Empire model , and shall be of the glazed liguid flat plate type. Collectors shall be tested in conformance with ASHRAE 93-1986 and SRCC 100-81. The collectors shall be certified by the Solar Rating and Certification Corporation (SRCC) and the Florida Solar Energy Center (FSEC).

GENERAL

The dimensions of the collector shall be _ inches in length, inches in width and 3 1/4 inches in depth. The collector casing shall be an anodized aluminum extrusion (alloy 6063 T5), minimum thickness .060 inch, with an architectural dark bronze finish. The casing shall have notched framewalls for ease of plate removal and reinstallation. Sheet metal screwed fasteners shall be stainless steel (18-8 #10). The backsheet shall be textured aluminum not less than .014 inch thickness. A 1 inch vent plug shall be installed in each of the four corners of the backsheet to minimize condensation.

GLAZING

The collector glazing shall be one sheet of low iron tempered glass, with a minimum of 1/8 inch thickness (5/32 inch on EC/EP 40), and a minimum transmissivity of 91 percent (89 on EC/EP 40). The glazing shall be thermally isolated from the casing by a continuous EPDM gasket. There shall be a continuous secondary silicone seal between the glass and casing capstrip to minimize moisture from entering the casing.

INSULATION

The insulation shall be foil-faced polyisocyanurate foam sheathing board of a minimum 1 inch thickness, siliconed in place to the aluminum backsheet, covered by low-binder fiberglass of a minimum 1 inch thickness, providing

(Performance specifications subject to testing error of +/- 3%)

thermal isolation of the foam from the absorber plate. Total thermal resistance shall be a minimum of R-12. The sides and ends of the collector shall be insulated with a minimum of 1 inch foil-faced polyisocyanurate foam sheathing board.

ABSORBER PLATE AND PIPING

The absorber shall consist of a roll-formed copper plate of no less than .008 inch thickness. Risers shall be a minimum of 1/2 inch O.D. Type M copper tubing on no more than 4 1/2 inch centers continuously soldered to the plate utilizing a non-corrosive solder paste with a melting point of 460°F. The risers shall be brazed to 1 1/8 inch O. D. Type M (1 5/8 inch O.D. on EC/EP40-1.5) copper manifolds utilizing a copper phosphorous brazing alloy with no less than 15 percent silver content, and conforming to the American Welding Societys BCuP-5 classification. EPDM grommets shall isolate the manifold from the aluminum casing. The absorber plate shall be designed for 160 psig maximum operating pressure.

ABSORBER COATING AND PERFORMANCE CURVE

A) Black Chrome (EC Series): The absorber coating shall be black chrome on nickel with a minimum absorptivity of 95 percent and a maximum emissivity of 12 percent. The instantaneous efficiency of the collector shall be a minimum Y-intercept of 0.714 and a slope of no less than -0.7271 (BTU/ft²-hr)/F.

B) Moderately Selective Black Paint (EP Series): The absorber coating shall be a moderately-selective black paint with a minimum absorptivity of 94 percent and a maximum emissivity of 56 percent. The instantaneous efficiency of the collector shall have a minimum Y-intercept of 0.682 and a slope of no less than -0.7995 (BTU/ft2-hr)/F.

Due to SunEarth's policy of continuous product improvement, specifications are subject to change without notice.

