


# A T-K2 or T-K1S with Storage Tank





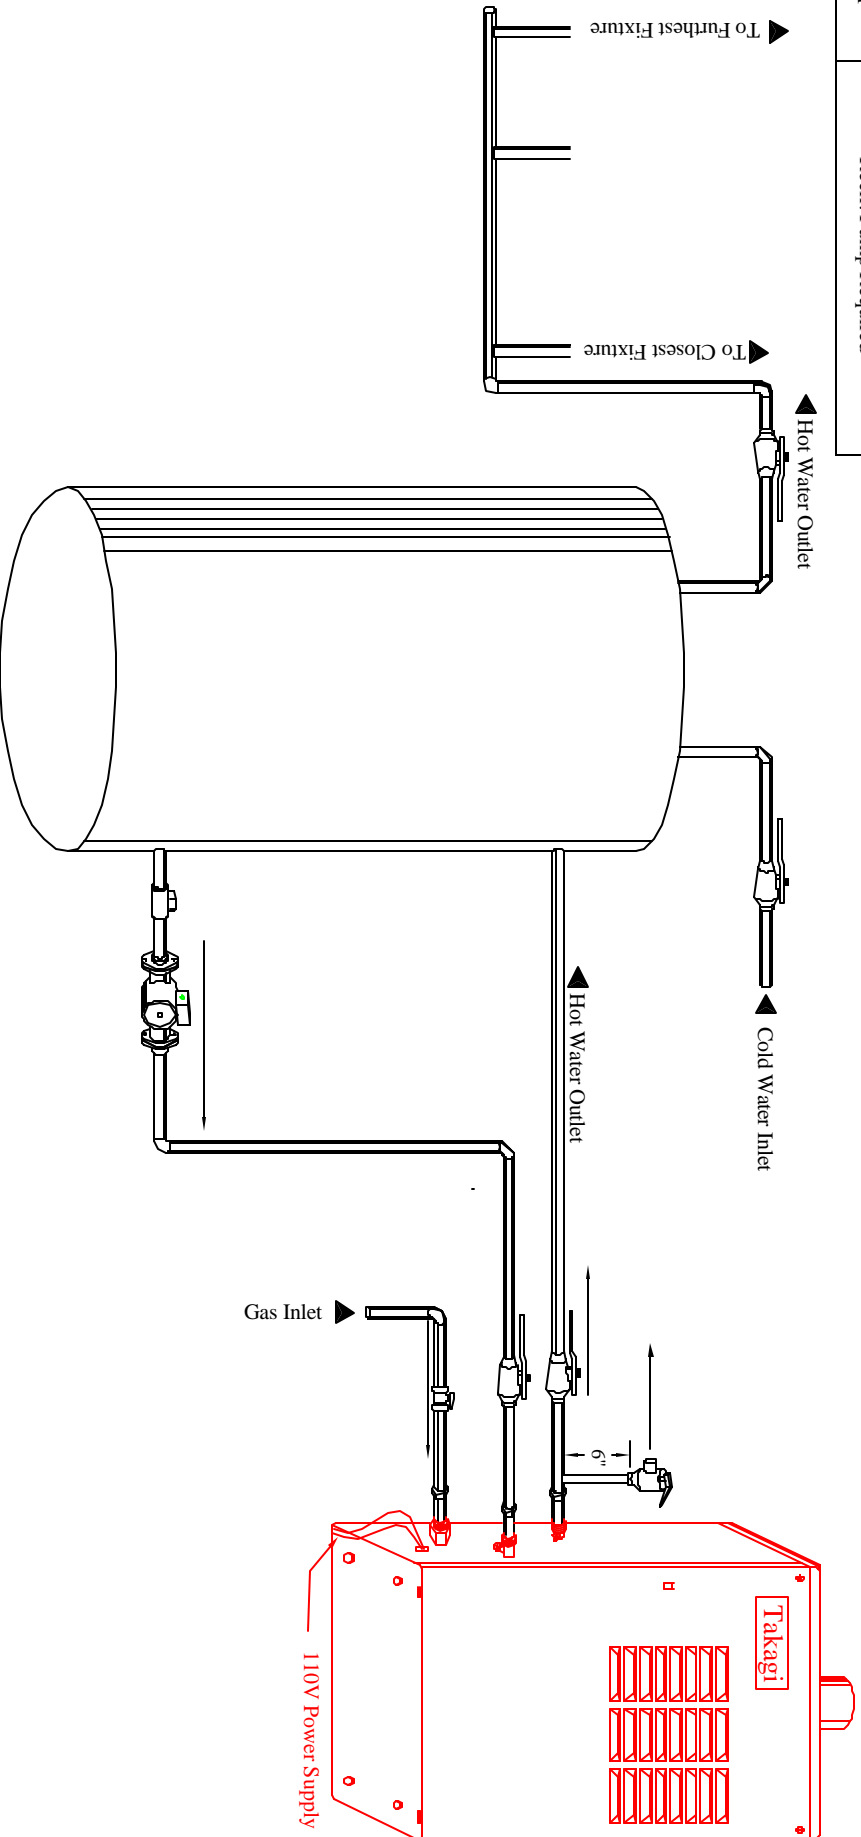

QTY	Basic Application Specs.
1	T-K2 or T-K1S
1	TK-TV03
1	TK-RE01 Optional
1	Recir. Pump Required



Note: This drawing is intended as a basic guide. Local and State Codes dictate correct installation. Each individual application, pump size, and gas pipe diameter must be sized correctly.

**Takagi USA**

3-B Goodyear  
 Irvine, CA 92618  
 Phone: (888) 882-5244  
 Fax: (949) 770-3171  
 www.Takagi-USA.com

	Recirculation Pump Min. 1/12 Hp		Pressure Only Relief Valve		Min. Ø 3/4" Gas Shut-off Ball Valve
	Water Shut-off Ball Valves		Unions		Check Valves