



Outdoor Installation

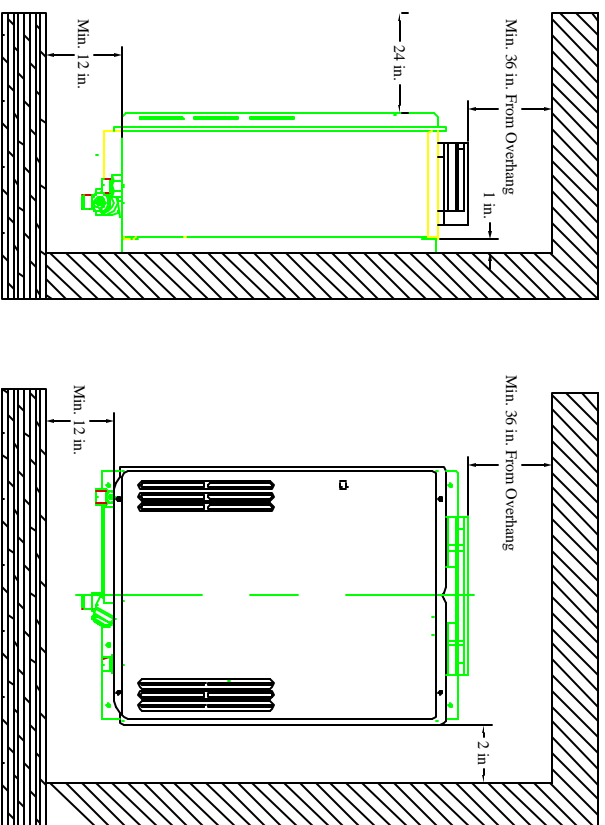

Indoor Installation

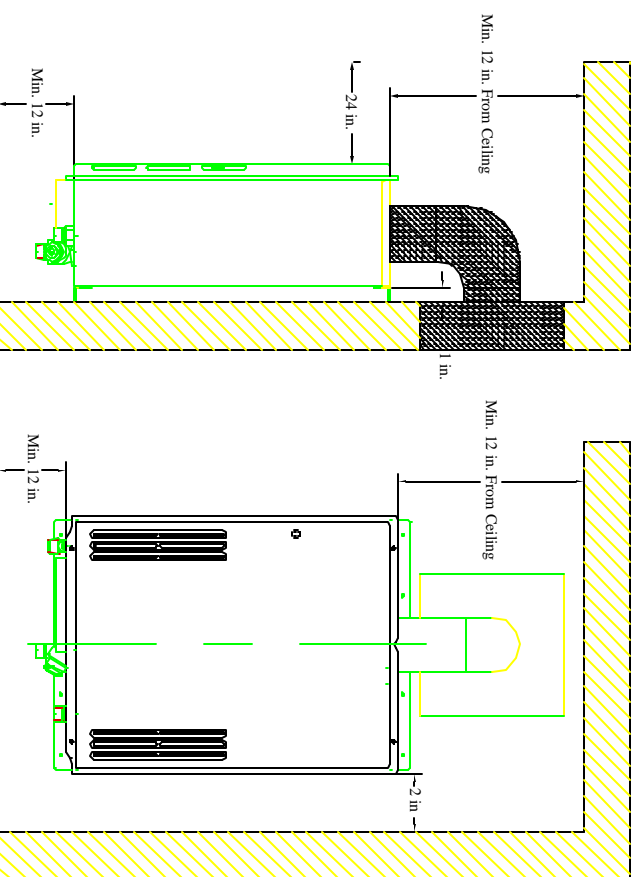

Minimum recommended Air Supply to Water Heater

| | |
|------------------|-----------------|
| Outside Air Area | Inside Air Area |
| 59 Sq. In. | 235 Sq. In. |

Flue Vent

| | | |
|----------|--------------------|---|
| Diameter | Max. No. of Elbows | Max. Vertical or Horizontal run in Length |
| 4 in. | 3 | 35 ft. |

Deduct 5 ft. from max. length for each added 90 degree elbow

Note: All dimensions are not proportional

